



див.аркуш 3 опитувального листа



Architectural floor plan of a long, narrow room, likely a corridor or hallway, showing various rooms and structural elements. The plan includes dimensions, room numbers, and labels for structural components like columns and beams. The layout is symmetrical around a central axis. Rooms are labeled with numbers and letters: 9Т1, 8Л, 7Л, 6Л, 5С, 4Л, 3Л, 2Л, 1Т2. Structural elements include columns (ЩО-1, ЩО-2), beams (3.1, 3.2, 3.4, 3.7, 3.8, 3.9, 3.10), and walls (3.1, 3.2, 3.3, 3.4, 3.5, 3.6, 3.7, 3.8, 3.9, 3.10). Dimensions are given in millimeters (mm) and meters (m). The total length of the room is 172,40 meters. The width is 600 mm. The plan also shows a central corridor with a width of 1200 mm and a central door opening of 1200 mm. The rooms are separated by walls and have various door types (e.g., 9Т1, 8Л, 7Л, 6Л, 5С, 4Л, 3Л, 2Л, 1Т2). The plan is drawn in a technical style with clear lines and labels.


Формат АЗ

Опитувальні дані		
Порядковий номер за планом		
Номінальна напруга, В		380
Номінальний струм, А		2860
Електродинамічна стійкість збірних шин, кА		
Матеріал та переріз збірних шин, мм		АД31т 10х100
Матеріал та переріз шин PEN, мм		АД31т 10х100
Тип панелі		
Призначення панелі		
Тип апарату	Автомат	Тип
		Струм, А
	Рубильник	Тип
		Струм, А
	Автоосвітлення ТП	
Номінальний струм автоматичного вимикача (запобіжник)		
Межі уставок по струму розчилювача, А	Тепловий	
	Електромагнітний	
Витримка часу захисту відструму к.з.,с		
Струм розчіплювача (плавкої вставки), А		
Трансформатори струму		Ін., А
Шкала амперметрів		
Тип шафи обліку		
Кількість панелей (у т. ч. торцевих), шт.		
Назва об'єкту		
Замовник та його адреса		
Проектна організація та її адреса		

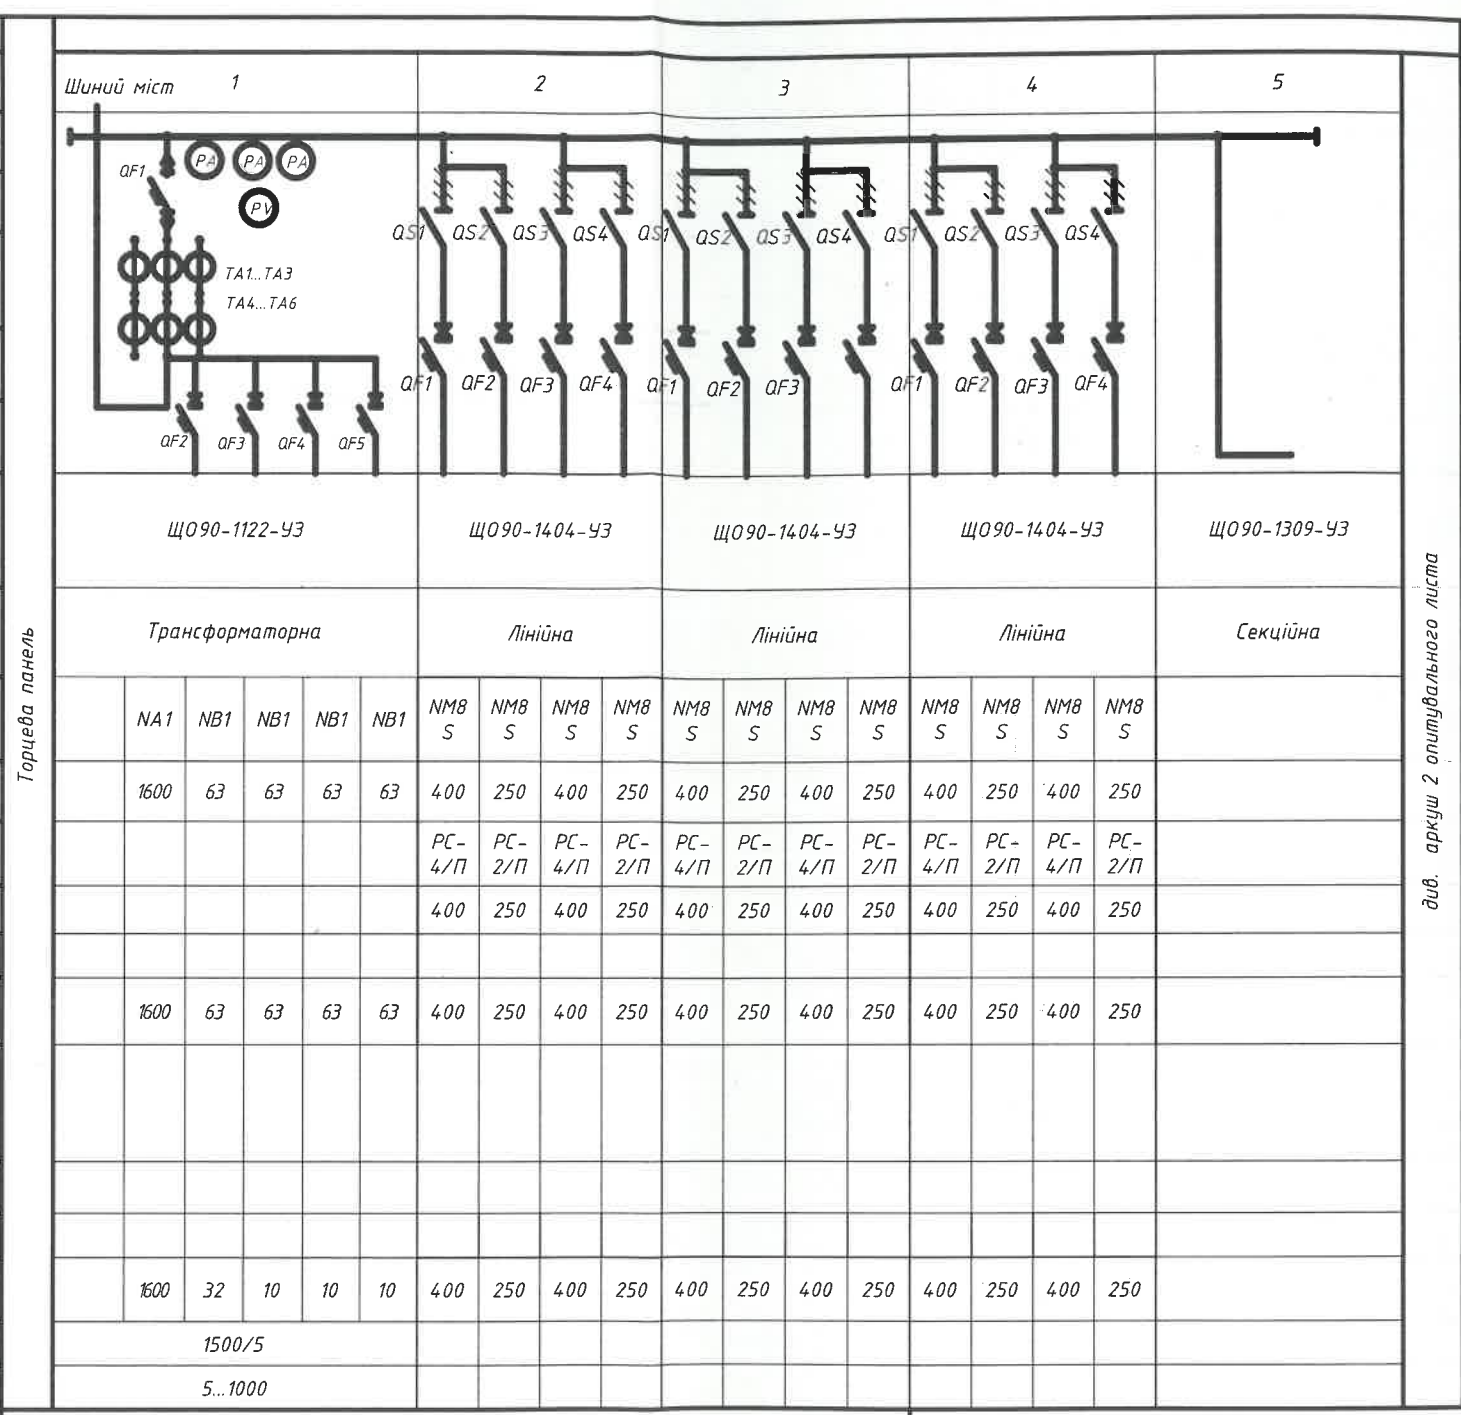

див. аркуш 2 опитувального листа

План розташування електрообладнання Іс.ш.РУ-0,4кВ (М1:50)

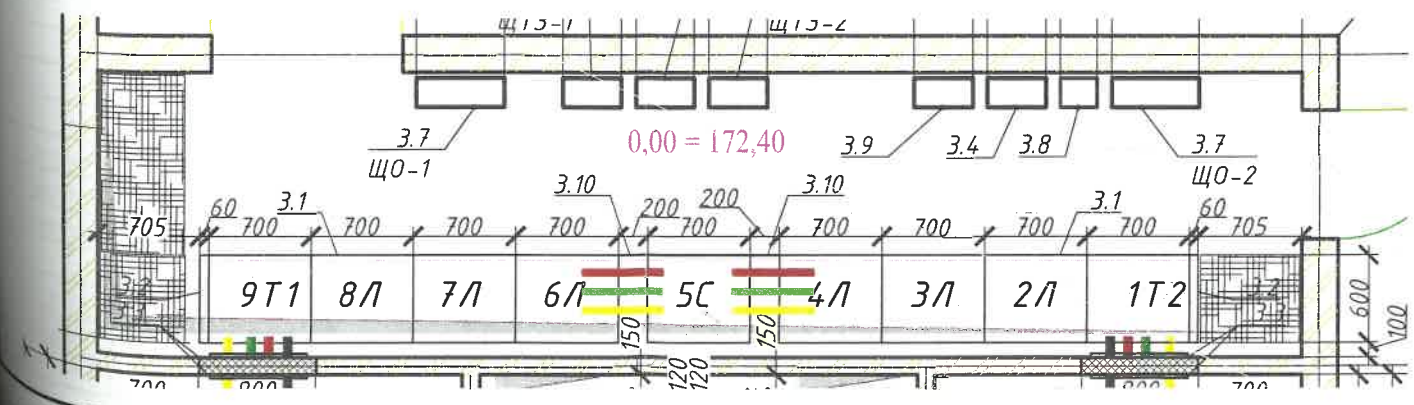

НП2-214-18-ЕП1.0/3				
Реконструкція з добудовою загальноосвітньої школи №22 по просп.Відрадний, 36В в м.Києві				
Зм.	Кіл.	Аркуш № док.	Підп.	Дата
Перевір.	Куклін О.С.			
Розроб.	Шеліган Ю.В.			
Електропостачання.			Стадія	Аркуш
Трансформаторна підстанція 10/0,4 кВ			РП	3
Опитувальний лист РУ-0,4 кВ (Іс.ш.)			ТОВ "Консенсус ТМ"	
Н.контр.	Дикун О.Ю.			
ГП	Куклін О.С.			